





TECHNICAL INSTRUCTION

Activating/deactivating trend data
OP12/15/16

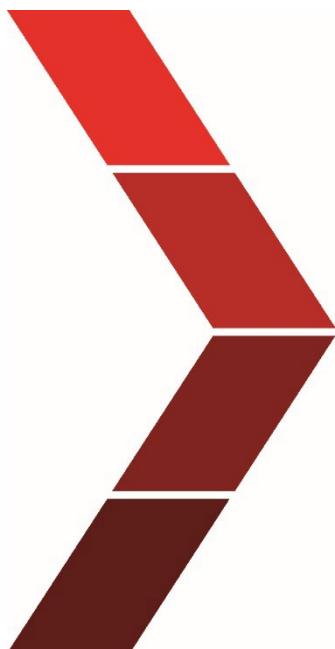


Description

The technical instruction describes the step by step process to activate or deactivate trend data on the OP12, OP15 and OP16

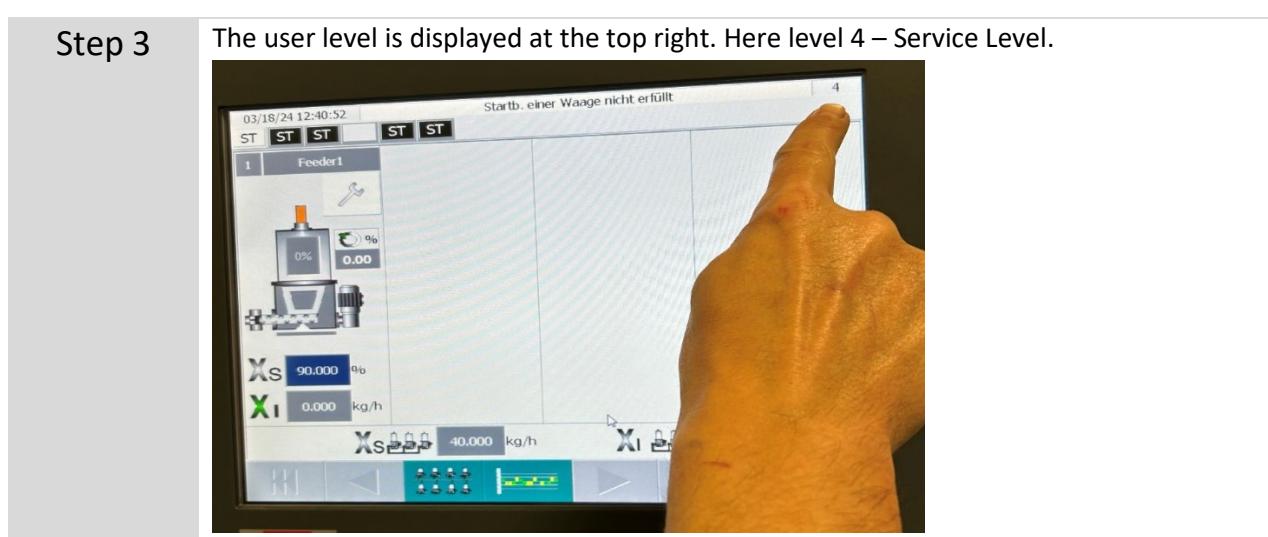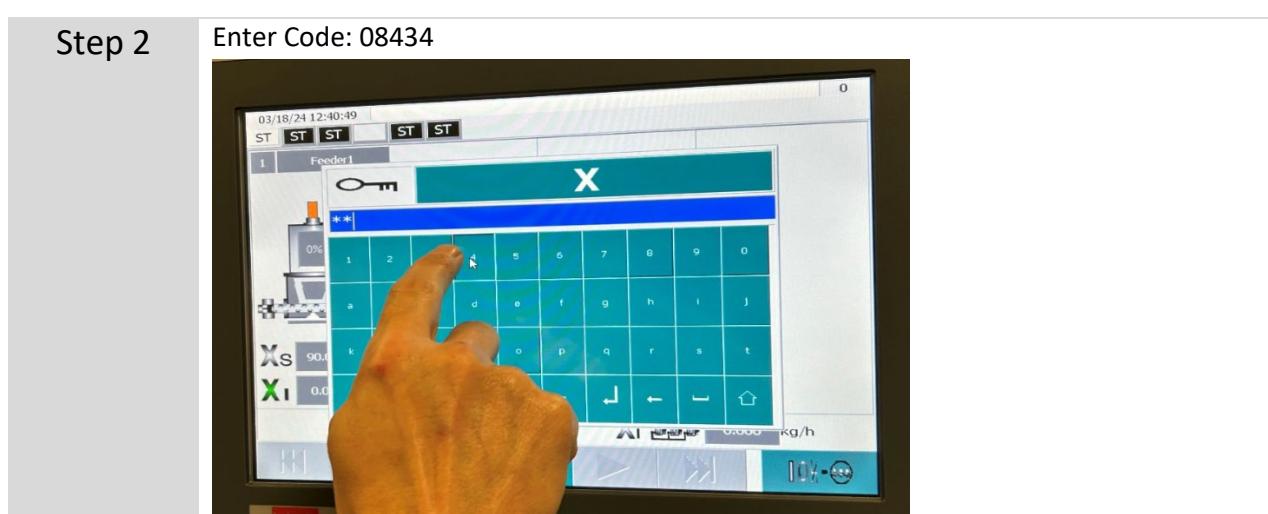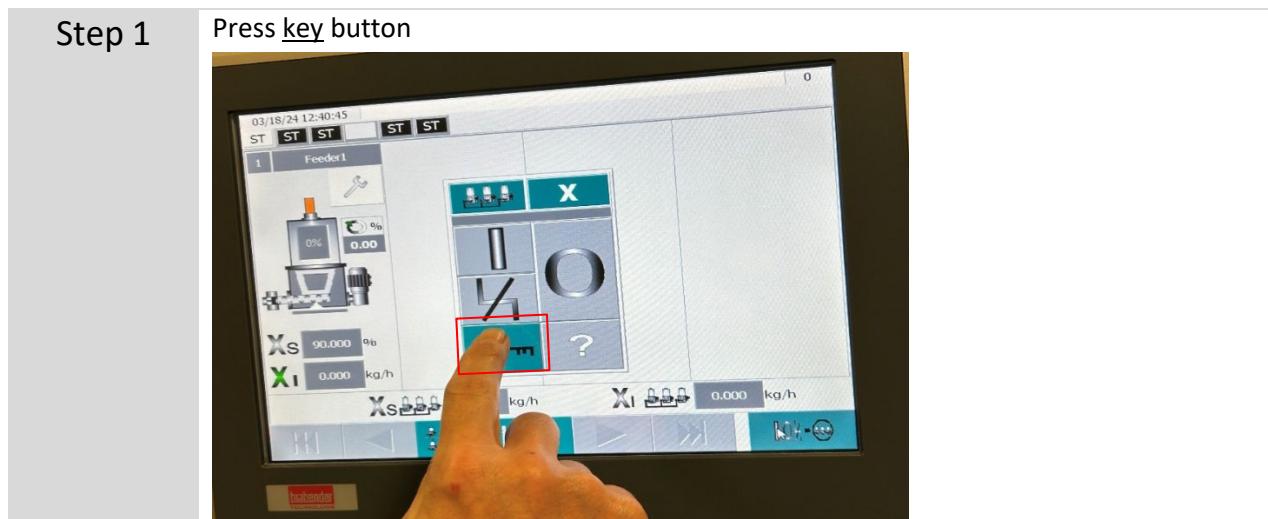


Step 4

Press button installation configuration.

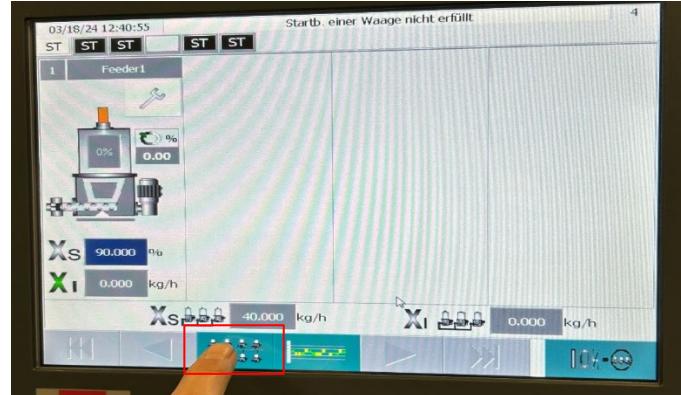


Step 5

Press button Component view of the selected components

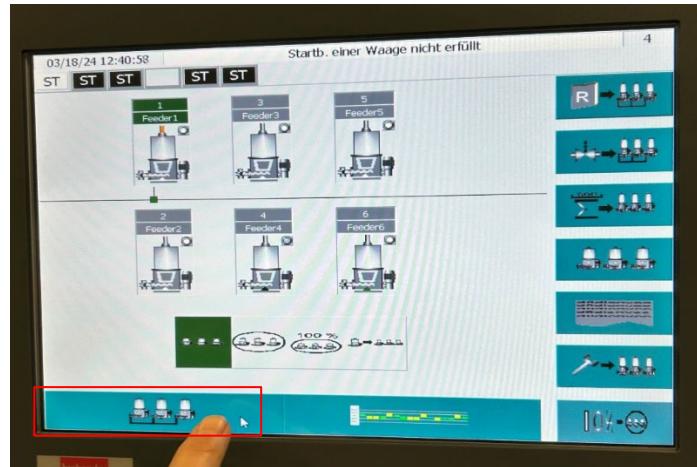

Step 6

Press on the feeder symbol. For Example feeder 1

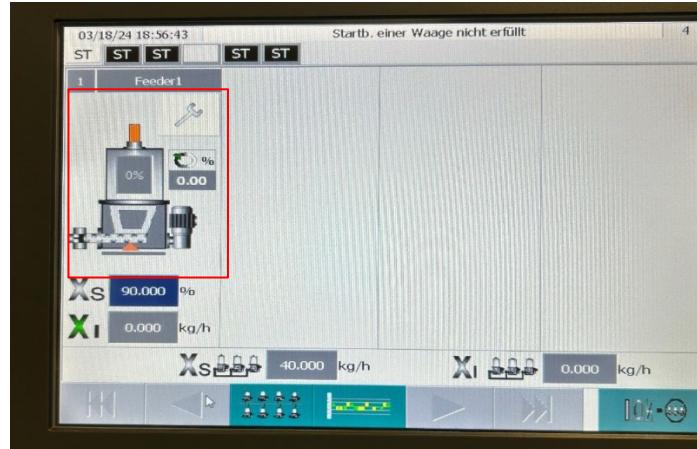


Step 7

Press button Service level for the component configuration




Step 8

Press button Trend

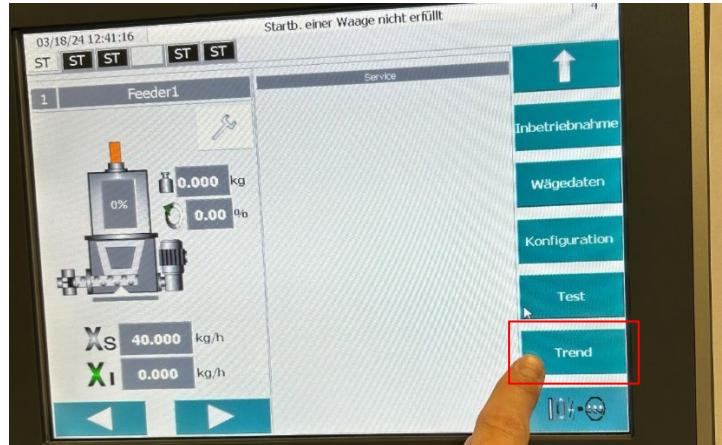

Step 9

0 = trend is selected to off

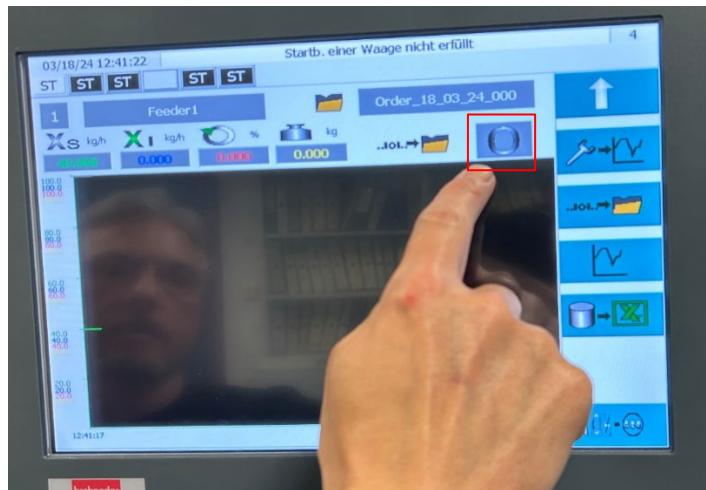

Step 10

Press button to open the button Trend I - O



Step 11

Press I = trend is selected to on



Step 12

The green I shows trend is now activated

